


PLAN
SIDEWALK ADJACENT TO CURB

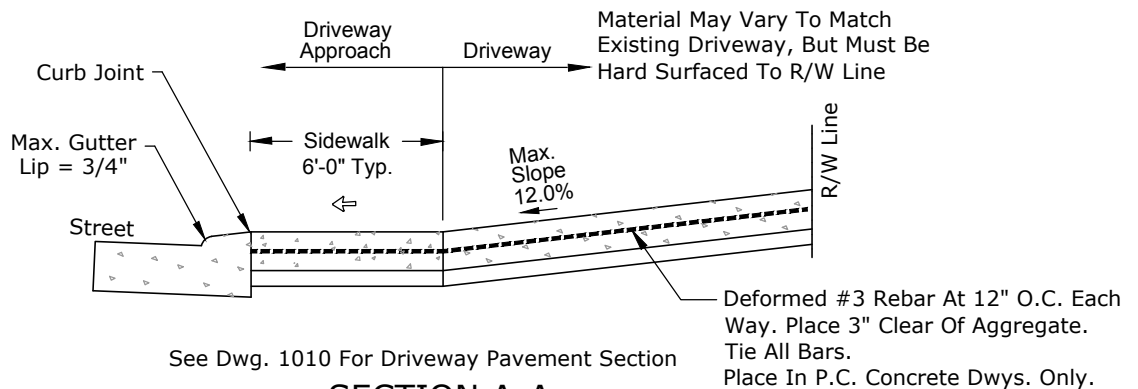

See Dwg. 1010 For Driveway Pavement Section

SECTION A-A

Not to Scale

GENERAL NOTES:

LEGEND:

- ↔ Slope 1.5% Max Design
Slope 2% Max Finish Grade
- ↔ Slope 7.5% Max Design
Slope 8.3 Max Finish Grade
See Note 6

1. Use Oregon Commercial Grade Concrete Per Section 00440.
2. Trowel Curb Joints With A Minimum 1/4" Radius Along Back Of Curb.
3. Place 3/8" Premolded Asphalt Impregnated Material Or Equal. Expansion Joints Extend From Subgrade To Finish Grade. Provide At Cold Joints, End Of Driveways And Each Side Of Inlet Structures.
4. Space Contraction Joints At A Max. Of 10'.
5. Design Slopes May Be Exceeded To Fit Existing Conditions, Not to Exceed Finish Grade Slope.
6. Slope May Be Exceeded If Ramp Length Is 15'.



WASHINGTON COUNTY
DEPARTMENT OF LAND USE &
TRANSPORTATION
ENGINEERING SECTION

**COMMERCIAL DRIVEWAY APPROACH
(CURBTIGHT SIDEWALK)**

PLOT STAMP: 07/11/24 9:42A KYLEL
CAD: 1050.DWG

EFFECTIVE DATE: **07/01/2024**

WASH. CO. # **1050**