

ADA Curb Ramp New Construction Inspection Form (Perpendicular)

North-South Road Name _____

Project No. _____

Sheet No. _____

Intersection No. _____

East-West Road Name _____


Calibration Date _____

(mm/dd/yy)


 o k
y t #

Ramp Style _____

		Pass	Fail
RAMP RUN 1			
Running Slope 1	≤ 8.3%	>8.3%	
Length 1			
Cross Slope 1	≤ 2.0%	>2.0%	
Detectable Warning (Y,N)	Y	N	
Lip Height	1/4"	>1/4"	
Gutter Flow Slope	N/A	≤ *	>*
Curb Running Slope (avg)	≤ 8.3%	>8.3%	
Counter Slope (+/-) *2	≤ 5.0%	> 5.0%	

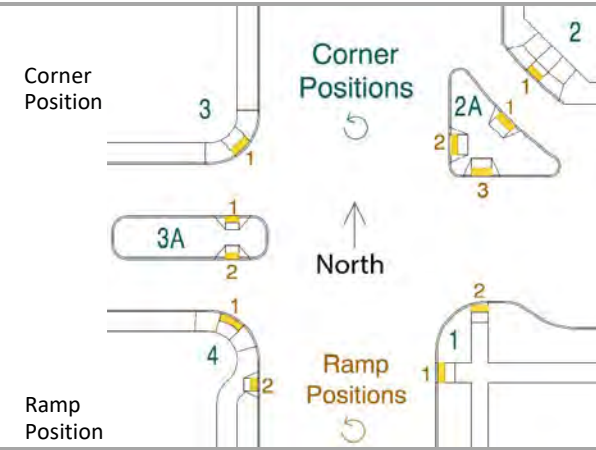

PE Stamp (required for private development)

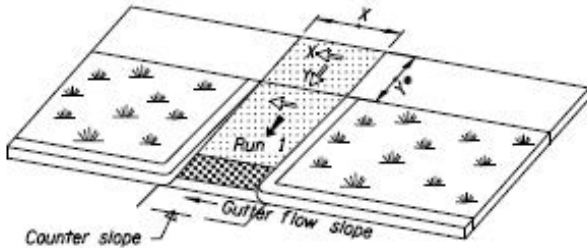See also Standard Drawings to assess provisions not shown: (inlets, alignment, etc.)


Longest distance from corner to back of curb (see dwg on BT form)	< 5.0'	≥ 5.0'
Detectable warning extends full width of ramp throat opening	Y	N

	LANDING	NONE	Pass	Fail
Width X		≥ 4.0'	< 4.0'	
Length Y		≥ 4.0'*1	< 4.0'*1	
Back of Ramp Obstruction (Y/N)		≥ 5.0'*1	< 5.0'*1	
Slope X		≤ 2.0%	> 2.0%	
Slope Y		≤ 2.0%	> 2.0%	

Comments: _____

PERPENDICULAR RAMP (PR)

- Pedestrian Access Route (to measure Clear Width)
- Detectable Warning Surface
- Cross Slope (2.0% max.)
- Running Slope (8.3% max.)
- Counter Slope (5.0% max.)
- Turning Space (X & Y) (2.0% max. / 4' x 4' min.)*
* If constrained at back of walk, min. Y length is 5'.
- Gutter Flow Slope (as directed)

	Traversable	Pass	Fail
Flare Slope 1	≤ 10%	< 10%	
Flare Slope 2	≤ 10%	< 10%	
Clear Width (feet)	≥ 4.0'	< 4.0'	
Intersection Control Type	Slope of Road		
Horizontal Gaps	≤ 1/2"	> 1/2"	

Inspector's Signature _____ Date (mm/dd/yyyy) _____

Print name clearly _____ Certification No. _____

Company/Agency _____

ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed